



ISTRUZIONI PER L'INSTALLAZIONE DEL GUSCIO ANTICONDENSA IN POLIETILENE RETICOLATO ESPANSO


La coibentazione dei collettori si effettua utilizzando i seguenti componenti:

Art.9303 102	Coibentazione per collettori 2 vie da 1" con interasse	50mm
Art.9303 103	Coibentazione per collettori 3 vie da 1" con interasse	50mm
Art.9303 104	Coibentazione per collettori 4 vie da 1" con interasse	50mm
Art.9303 11402	Coibentazione per collettori 2 vie da 1¼" con interasse	50mm
Art.9303 11403	Coibentazione per collettori 3 vie da 1¼" con interasse	50mm
Art.9303 11404	Coibentazione per collettori 4 vie da 1¼" con interasse	50mm


VF108 EDIZIONE N° 4: 27/02/12

INSTALLAZIONE SUI COLLETTORI


1. Installare i collettori ed eseguire tutti gli allacciamenti necessari.

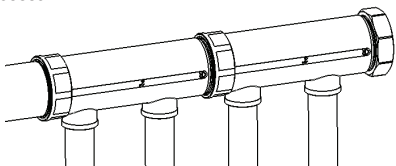


3. Porre i gusci sul collettore facendo in modo di far combaciare gli stessi sulla giunzione dei collettori.

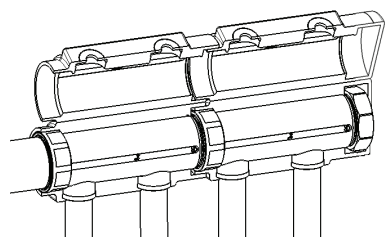

4. Chiudere il guscio in modo da fare aderire la superficie interna al collettore. Fissare il guscio per mezzo degli adesivi già presenti sul guscio.

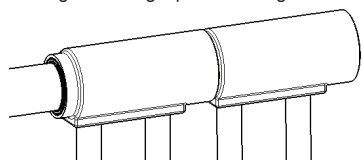


2. Per collegare in serie più collettori coibentati, è sufficiente tagliare il guscio in corrispondenza delle linee marcate già tracciate all'interno del guscio.




Effettuare i tagli in base alle proprie esigenze impiantistiche

Per installare i gusci con i supporti art.7480-7550, effettuare il taglio del guscio in corrispondenza dei supporti come rappresentato in figura.

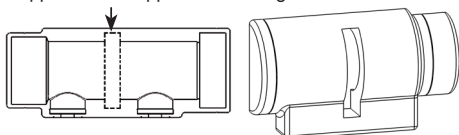

Successivamente inserire il guscio sul supporto e installare il collettore.

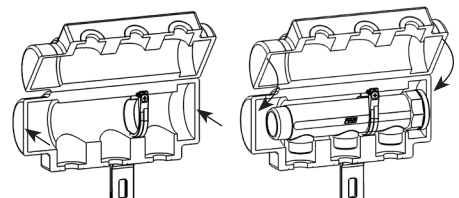

CARATTERISTICHE TECNICHE

Materiale: Polietilene Reticolato Espanso
Reazione al fuoco (Italia:DM 26.06.84): Classe 1




INSTALLATION INSTRUCTIONS FOR EXPANDED POLYETHYLENE ANTI-CONDESATION PROTECTION SHELL

Manifold insulation is carried out by means of the following components:


Art.9303 102	insulation shell for 2 port manifold, size 1" with	50mm centre line between ports
Art.9303 103	insulation shell for 3 port manifold, size 1" with	50mm centre line between ports
Art.9303 104	insulation shell for 4 port manifold, size 1" with	50mm centre line between ports
Art.9303 11402	insulation shell for 2 port manifold, size 1¼" with	50mm centre line between ports
Art.9303 11403	insulation shell for 3 port manifold, size 1¼" with	50mm centre line between ports
Art.9303 11404	insulation shell for 4 port manifold, size 1¼" with	50mm centre line between ports

INSTALLATION ON MANIFOLDS


1. Install manifolds and make all necessary connections.

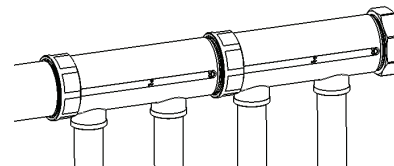


2. Place shells on the manifolds so that both sides match up.

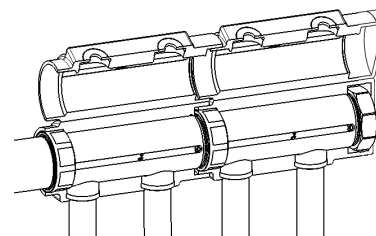

3. Close the shell so as to seal the inner surface to the manifold. Fix the shell by means of adhesives already placed on the shell

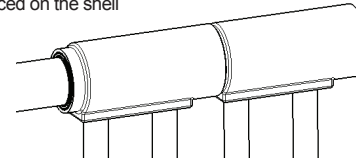


2. To connect insulated manifolds, simply cut the shell at the marked lines already drawn inside the shell.




Make the cuts to suit your installation requirements

To install the shells with the supports, art. 7480-7550, use the cutting guide in the shell that corresponds to the supports, as shown in the picture.

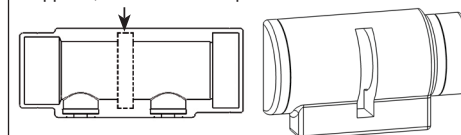

Then insert the shell on the support and install the manifold.

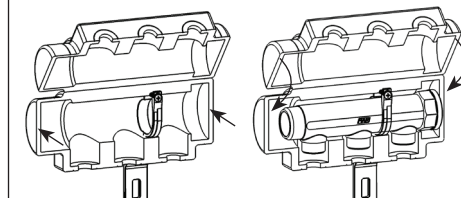

TECHNICAL FEATURES

Material: expanded polyethylene
Fire reaction (Italy: DM 26.06.84): Class 1